


Information in brief ProMinent® gamma/ L

1 Operating

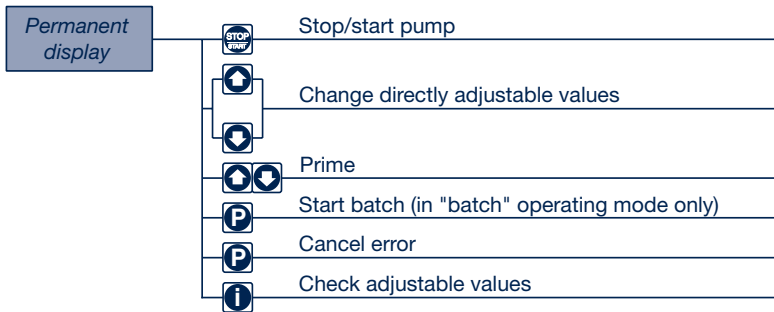


ProMinent®

2 Change directly adjustable values


with and change from permanent display to corresponding operating mode.

	Permanent display	In operating mode
Stroke rate	Stroke rate	Manual Contact Batch
Feed rate	Feed rate	Manual

3 Menu structure

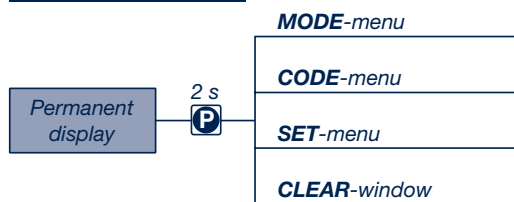

4 Calibrating

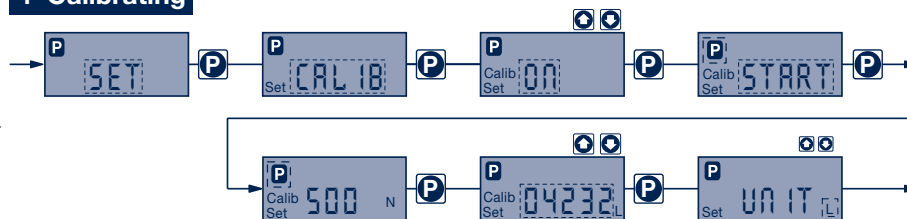

5 Useful operating guidelines

- Press 3 s to return to permanent display from any other display.
- Press to switch to numerical entry.
- Return to number 1 after numerical input: 2 x .

The manufacturer will be pleased to supply a list of distributors:
ProMinent Dosiertechnik GmbH
Im Schuhmachergewann 5-11 · 69123 Heidelberg · Germany
P.O. Box 101760 · 69007 Heidelberg · Germany
Phone +49 (6221) 842-0 · Fax +49 (6221) 842-419
info@prominent.de · www.prominent.de



BA G 014 09/00 GB